

Environmental Report ('ER') – Volume 2 Appendices

**Proposed 110kV Substation and
Underground Grid Connection
at
Killoran, Co. Tipperary**

**On behalf of
Soleirtecity Lisheen Ltd**



**Environmental Report ('ER') – Volume 2
Proposed 110kV Substation and Underground Grid Connection
Soleiricity Lisheen Ltd
Killoran, Co. Tipperary**

APPENDICES

Appendix 1-1: ACP SID Determination

Appendix 1-2: Site Context

Appendix 5-1: Site Layout Drawing

Appendix 7-1: Lisheen TMF Annual Review

Appendix 7-2: Lisheen Mine AER 2024


Appendix 8-1: Noise Glossary

Appendix 8-2: Model Inputs

Appendix 8-3: Model Outputs

Appendix 9-1: Photomontages

APPENDIX 1-2

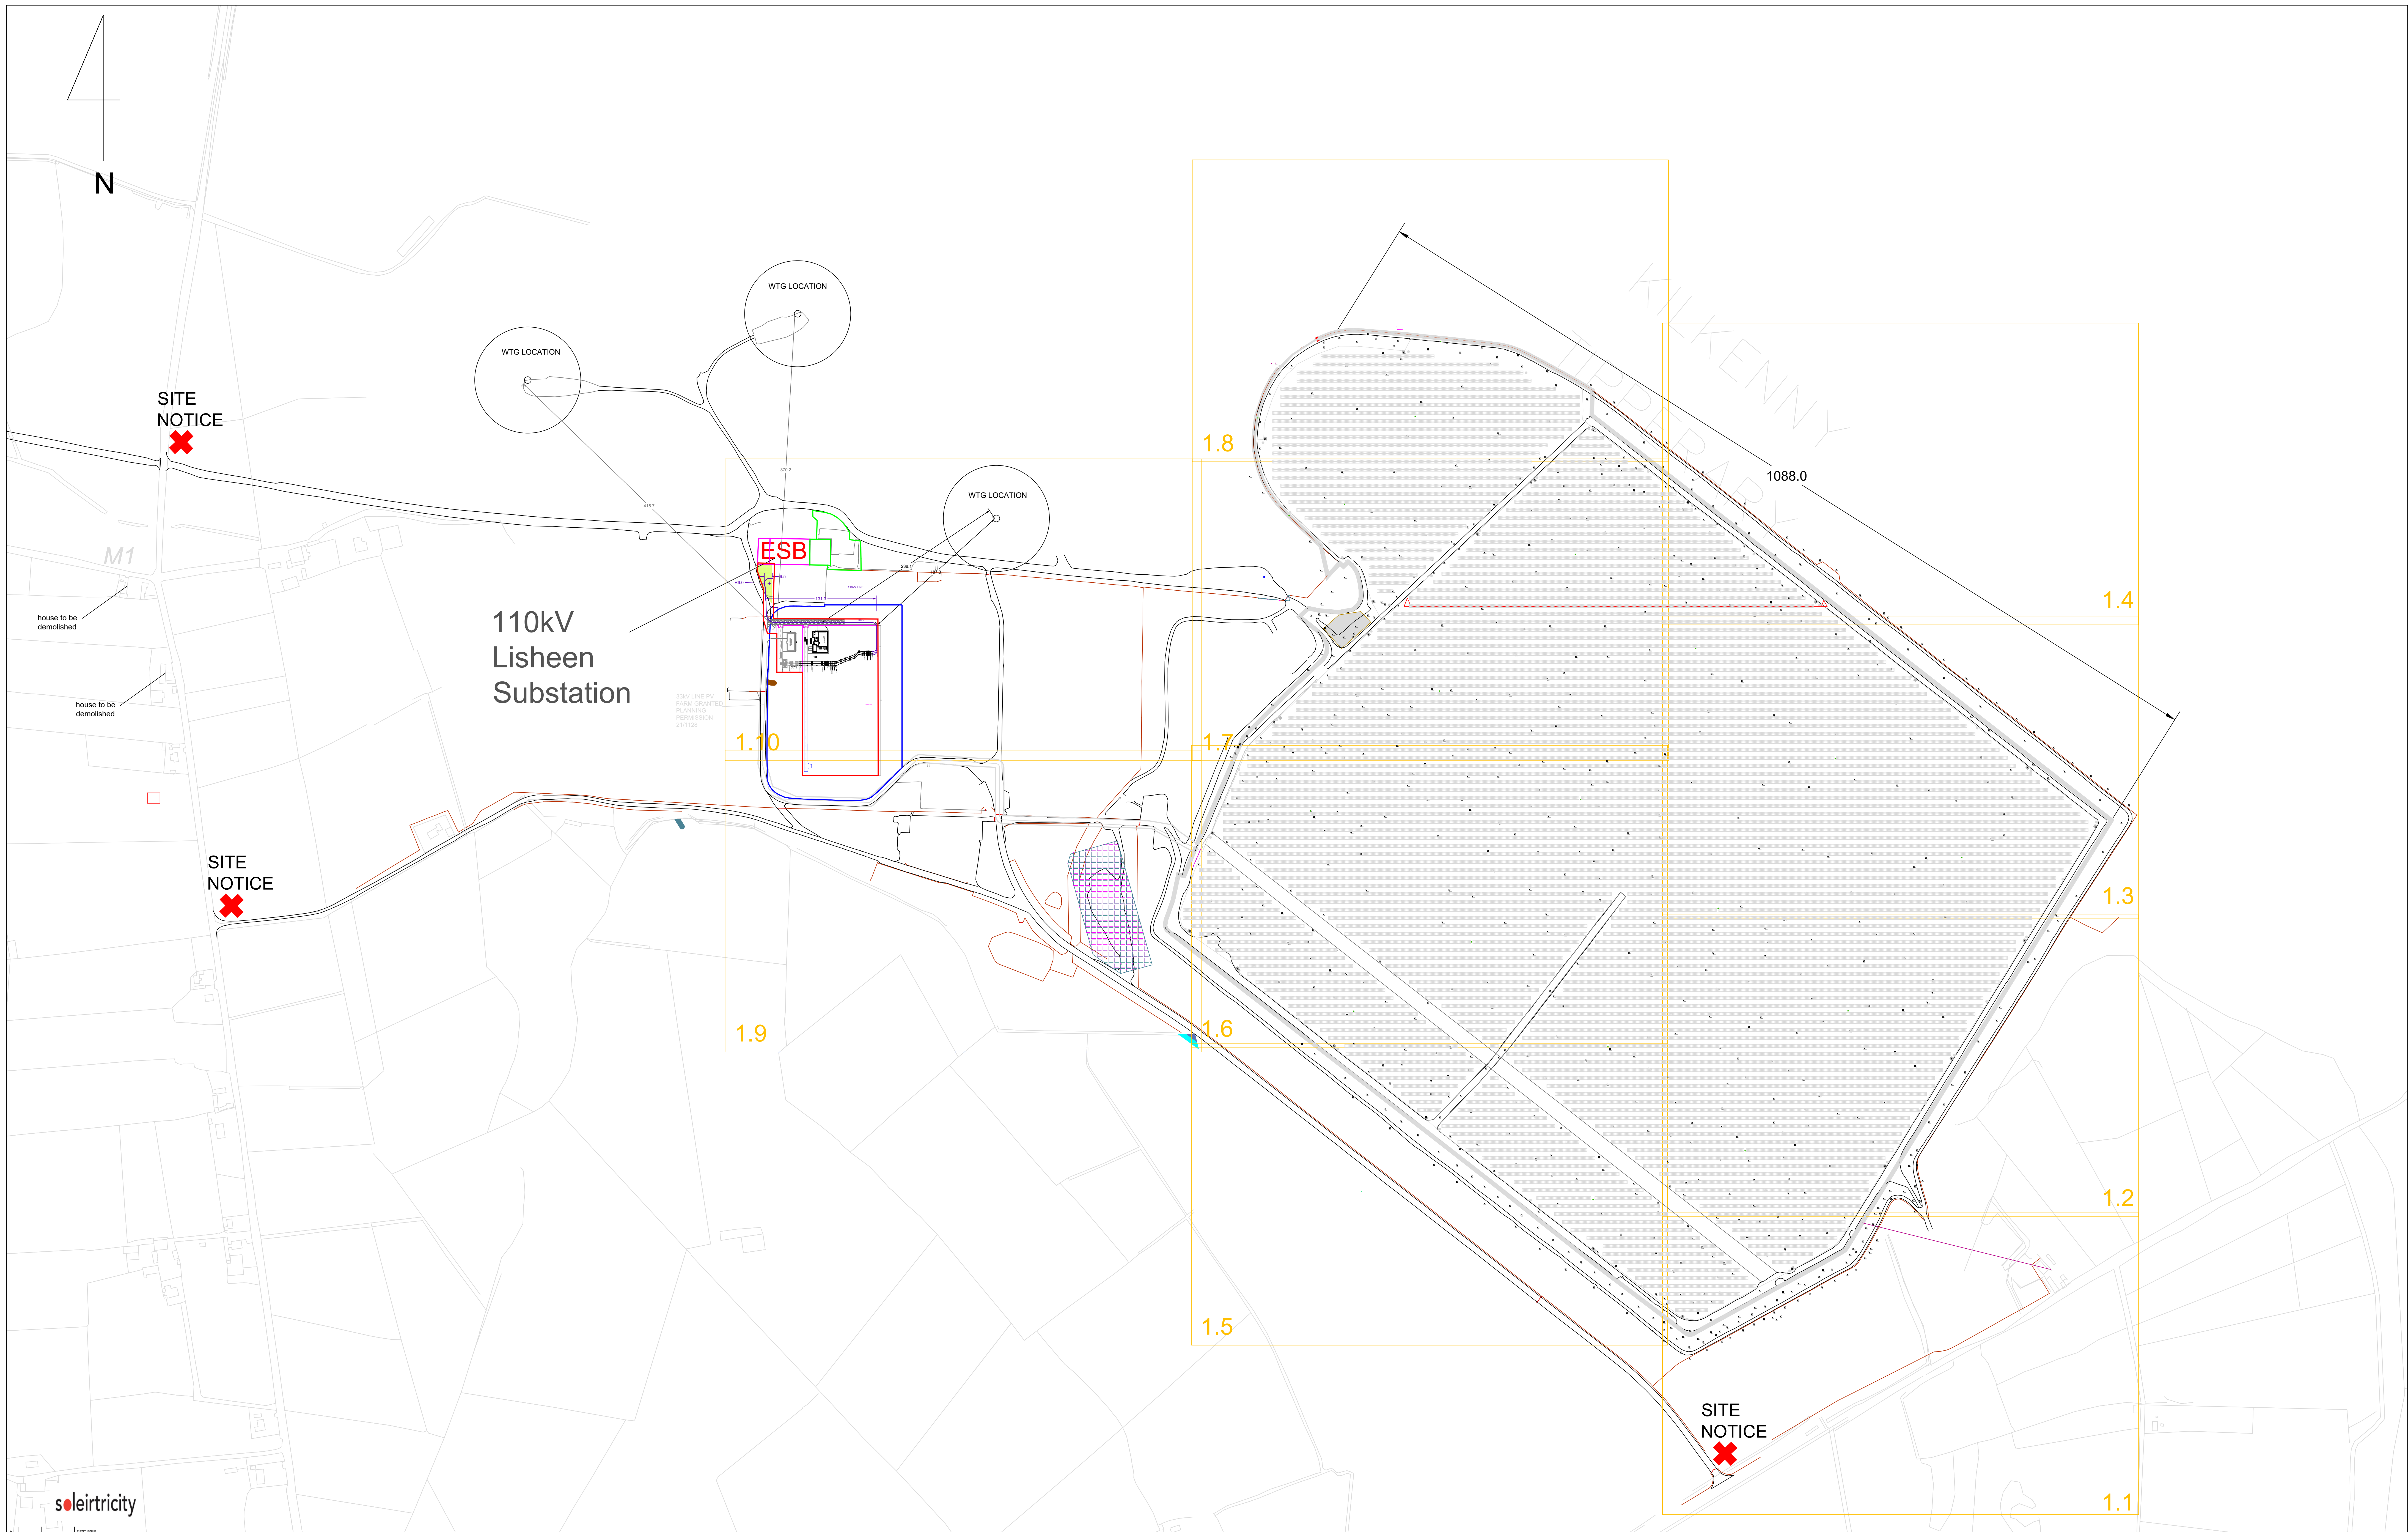



 MKR Consulting
 Reymonta 13/17
 41-815 Zabrze
 Poland
 Tel: +48502698323
 email: kras.marek@gmail.com

PROJECT: Cooleeney Substation Compound
 TITLE: SITE LOCATION PLAN

SCALE: 1:2500	STATUS: PRELIMINARY
FORMAT: A0	DRAWN BY: M.K. CHECKED AND APPROVED: E.W.
PROJECT PHASE: PLANNING	DATE: 14.01.2026 DATE: 14.01.2026
SUBJECT: COOL d002	REVISION: F

- LANDOWNER BOUNDARY
- PLANNING BOUNDARY
- 110kV LHM
- SUBSTATION FENCE
- PREVIOUSLY GRANTED PLANNING PERMISSION FOR A SOLAR FARM (PLANNING REF NO. 211128)
- PLANNED EXTENSION OF THE EXISTING GRID SUBSTATION